

T14-B370-22-046

WYT-J


注 意 事 项

1. TSG T7007—2022
 - 2.
 3. NETEC
" "
 4. NETEC
 5. NETEC
" "
 6. NETEC
 - 7.
 8. 15 NETEC
 9. " EN 81-20:2020 EN 81-50:2020"
CNAS
 10. NETEC NETEC
- NETEC
- 61 065000
- 0316-2311414 2632627 0316-2057334
- Email netec@chinaelevator.org
- www.netec-china.com

目 录

.....	1
.....	2
.....	3
.....	4
.....	6
.....	6
.....	6





			WYT-J
	8.00 m/s		1650 N·m
	14000 kg		
()	400 mm		+
		/	
	WYT-J4.0F2		
	54.9 kW		318 r/min
	380 V		115 A
	79.5 Hz		F
	S5-40%		IP41
			240 F/h
	/		/

测
★
报
告
电
量
★
报
告
电

(7)
转子)

检
转子)


1	X6.1	X6.1.1		
2		X6.1.2		
3	X6.2	X6.2.1		
4		X6.2.2		
5		X6.2.3		
6		X6.2.4		
7		X6.2.5	<p style="text-align: center;">U DC 110 V</p> <p>DC 65 V 59.1%U</p> <p>DC 33 V 30.0%U</p> <p>DC 32 V 28.2%U</p>	
8		X6.2.6		
		X6.2.7		

北京
用
实验
用

14	X6.3	X6.3.1		
15		X6.3.2		
16		X6.3.3	HBW 1 265 2 270 3 275 4 272 10	
17	X6.4			/
18	X6.5	X6.5.1	91.7 K 52.7 K	
19		X6.5.2	dB(A) 66.4 66.3 67.0 66.7 66.5 46.9	
20		X6.5.3		
21		X6.5.4	v 8.00 m/s 8.001 m/s 100.0%v	
22		X6.5.5		
23		X6.5.6		
24		X6.5.7		/
25		X6.5.8		/

上海申泰电梯有限公司
 SHANTAI
 检测中心
 SHANTAI

1	GB/T 7588.1— 2020 §5.9.2.2.2.6	()		

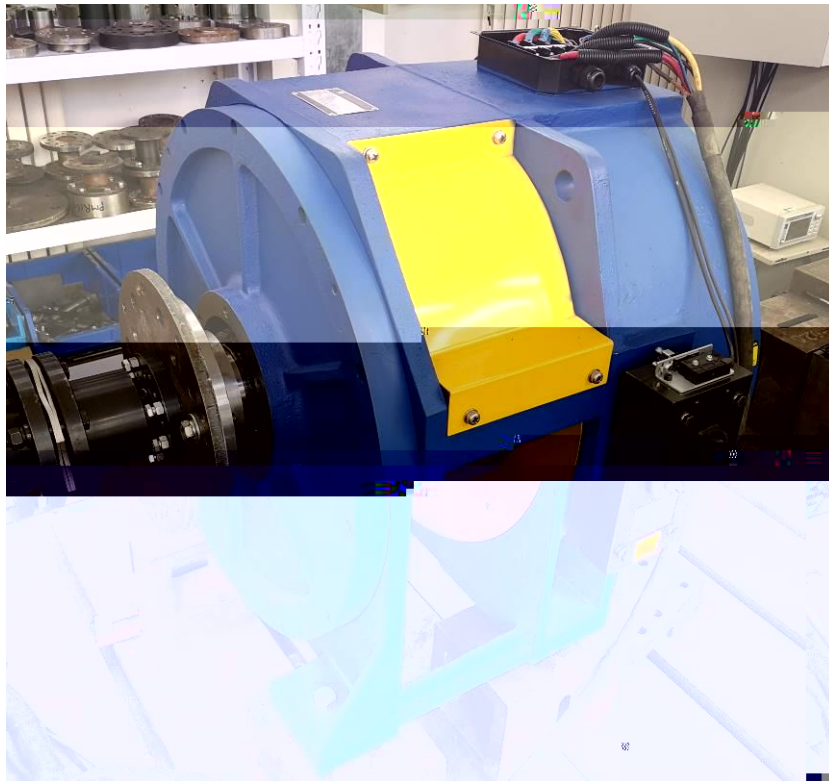

NETEC

NETEC

”

”

